


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 95.60 lm/W
MODEL	74002000300	Imax (cd)	876.1	S/MH(C0/180)	0.63	
NOMINAL POWER(W)	5	LOR(%)	100.0	S/MH(C90/270)	0.63	
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	437.65	η UP,DN(C0-180)	0.7,49.5	
NOMINAL FLUX(lm)	437.652	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.7,49.2	
LAMPS INSIDE	1	η up (%)	1.3	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	230	η down (%)	98.7	CIBSE SHR MAX	0.65	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

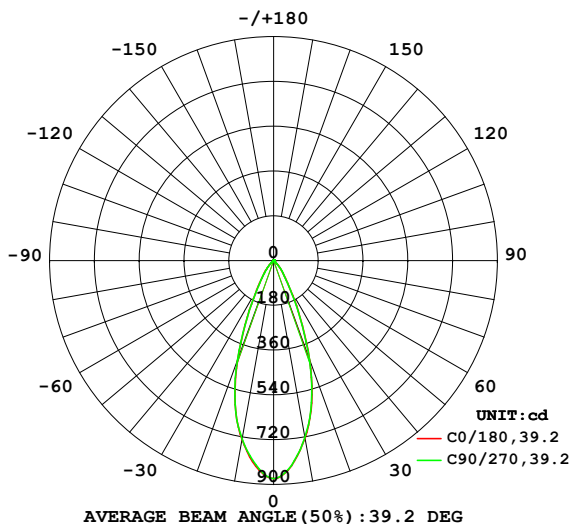

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

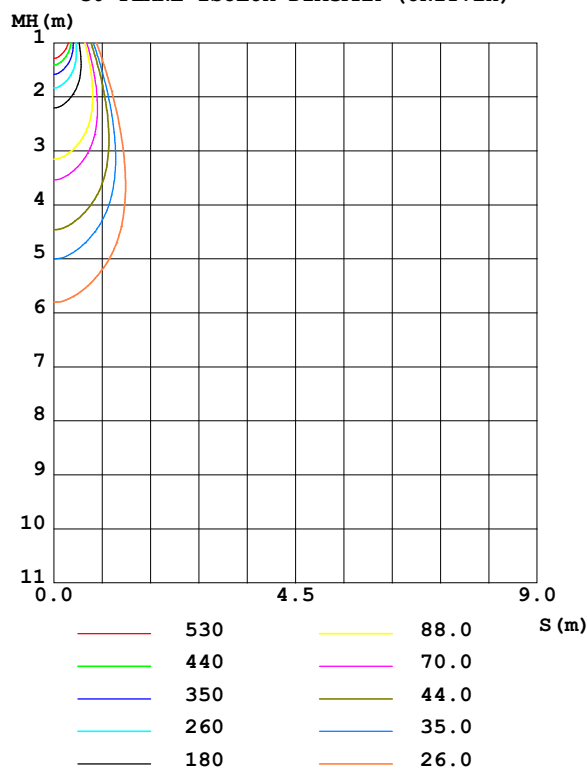

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	731.5	733.9	729.6	728.6	725.8	717.9	723.3	729.0	0- 10	75.71	75.71	17.3,17.3
20	422.6	429.8	426.4	425.9	424.0	415.2	421.7	422.2	10- 20	162.0	237.8	54.3,54.3
30	136.3	137.6	135.7	138.1	138.6	132.5	134.8	136.2	20- 30	117.4	355.1	81.1,81.1
40	45.44	45.52	45.53	47.38	47.34	45.70	46.02	45.79	30- 40	50.06	405.2	92.6,92.6
50	8.304	8.497	8.472	8.962	9.049	8.875	8.899	8.522	40- 50	17.77	422.9	96.6,96.6
60	2.904	2.859	2.769	2.800	2.814	2.849	2.983	2.983	50- 60	4.062	427.0	97.6,97.6
70	1.797	1.730	1.655	1.615	1.637	1.729	1.812	1.953	60- 70	2.191	429.2	98.1,98.1
80	1.285	1.196	1.073	1.043	1.099	1.215	1.246	1.458	70- 80	1.553	430.8	98.4,98.4
90	0.8746	0.8066	0.7636	0.7093	0.7456	0.8386	0.8328	0.9316	80- 90	1.093	431.8	98.7,98.7
100	0.0666	0.1204	0.2568	0.1235	0.0724	0.0840	0.3329	0.0839	90-100	0.3075	432.2	98.7,98.7
110	0.1387	0.2178	0.3788	0.2169	0.1536	0.2297	0.3840	0.2247	100-110	0.2048	432.4	98.8,98.8
120	0.2945	0.3121	0.3930	0.3066	0.4198	0.3177	0.4487	0.3232	110-120	0.2801	432.6	98.9,98.9
130	0.7828	0.6629	0.7655	0.6699	0.8516	0.6993	0.7888	0.7073	120-130	0.4527	433.1	99,99
140	1.369	1.415	1.445	1.419	1.476	1.493	1.469	1.490	130-140	0.8188	433.9	99.1,99.1
150	2.480	2.320	2.398	2.318	2.553	2.401	2.428	2.407	140-150	1.197	435.1	99.4,99.4
160	3.072	3.124	3.108	3.098	3.131	3.112	3.156	3.151	150-160	1.280	436.4	99.7,99.7
170	3.466	3.422	3.409	3.378	3.428	3.358	3.421	3.399	160-170	0.9393	437.3	99.9,99.9
180	3.477	3.491	3.447	3.485	3.471	3.485	3.467	3.482	170-180	0.3278	437.7	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 417.25 lm

%lum = 95.3%

%lamp = 95.3%

Conical surface Flux(120deg): 427.01 lm

%lum = 97.6%


%lamp = 97.6%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Chen Songyu
 Test Date:2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
 Humidity:65.0%
 Test Distance:9.520m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

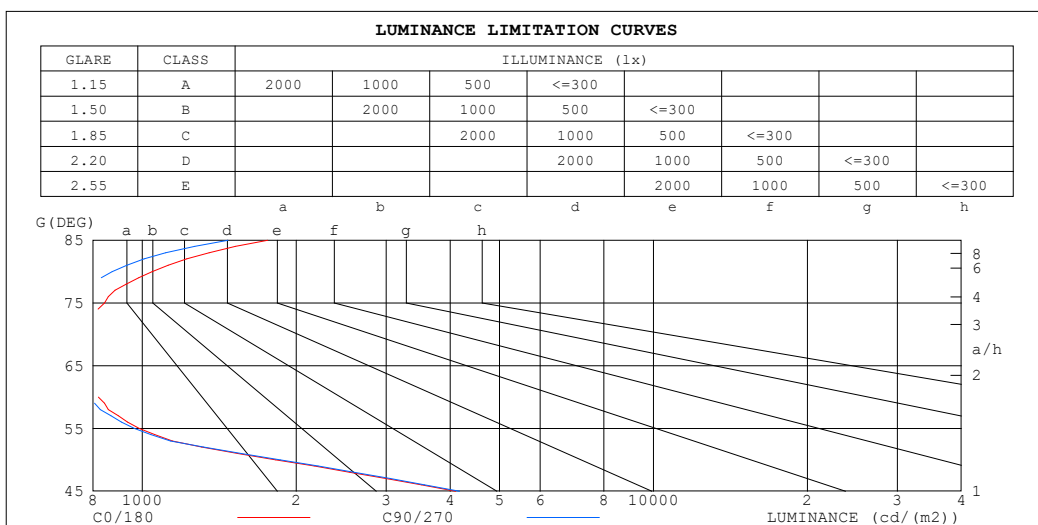

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1759	1472
80	1045	873
75	843	740
70	742	683
65	743	701
60	820	782
55	986	965
50	1824	1862
45	4098	4175


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Chen Songyu
Test Date: 2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 9.520m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

pcc	80%			70%			50%			30%			10%			0
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
p _{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

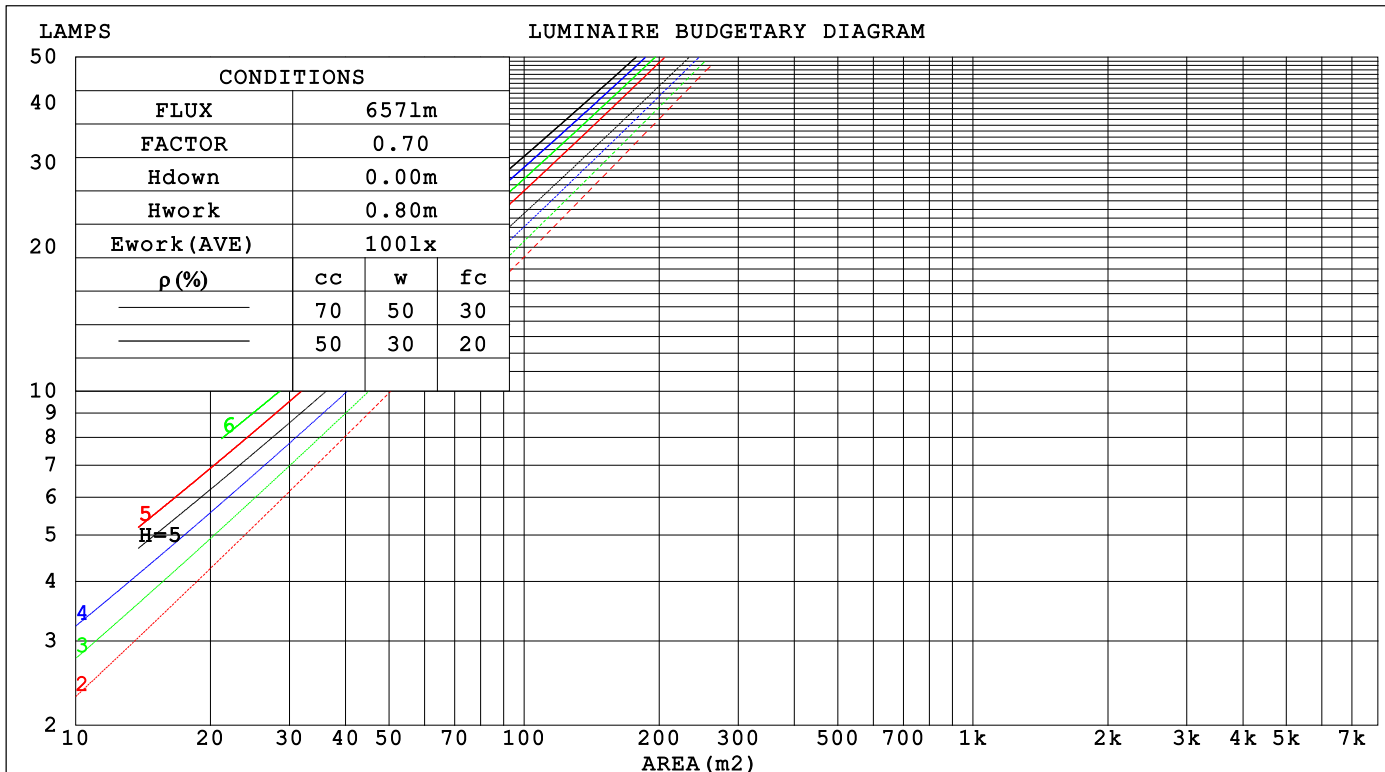

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz			UTHDi:0.00% ITHDi:0.00% KDisp:0			Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D			WHType: 5W			Weight:		
SPEC.: 5000K			DIM.:			Instrument No.: HUP-IES-B3		
MFR.: CALEX			SUR.: 0.0475			shielding angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.168	.096	.030	.161	.092	.029	.148	.085	.027	.136	.078	.025	.124	.072	.023		
2.0	.158	.087	.027	.152	.084	.026	.141	.078	.024	.131	.073	.023	.121	.069	.022		
3.0	.149	.079	.024	.144	.077	.023	.135	.073	.022	.126	.069	.021	.118	.065	.020		
4.0	.141	.073	.022	.137	.072	.021	.128	.068	.020	.121	.065	.020	.114	.062	.019		
5.0	.134	.068	.020	.130	.067	.019	.123	.064	.019	.116	.061	.018	.110	.059	.018		
6.0	.127	.064	.018	.124	.063	.018	.118	.060	.018	.112	.058	.017	.106	.056	.017		
7.0	.121	.060	.017	.118	.059	.017	.113	.057	.016	.107	.055	.016	.103	.053	.016		
8.0	.116	.057	.016	.113	.056	.016	.108	.054	.015	.103	.052	.015	.099	.051	.015		
9.0	.111	.054	.015	.108	.053	.015	.104	.051	.015	.100	.050	.014	.096	.049	.014		
10.0	.106	.051	.014	.104	.050	.014	.100	.049	.014	.096	.048	.014	.093	.047	.013		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.201	.201	.201	.171	.171	.171	.117	.117	.117	.067	.067	.067	.021	.021	.021		
1.0	.181	.168	.156	.155	.144	.134	.106	.099	.093	.061	.057	.054	.019	.018	.017		
2.0	.165	.143	.124	.141	.123	.108	.097	.085	.075	.056	.049	.044	.018	.016	.014		
3.0	.152	.124	.102	.130	.107	.088	.089	.074	.062	.052	.043	.036	.017	.014	.012		
4.0	.141	.109	.085	.121	.094	.074	.083	.066	.052	.048	.038	.031	.015	.013	.010		
5.0	.131	.097	.072	.113	.084	.063	.078	.059	.044	.045	.034	.026	.014	.011	.009		
6.0	.123	.088	.062	.106	.076	.054	.073	.053	.038	.042	.031	.023	.014	.010	.008		
7.0	.117	.080	.054	.100	.069	.047	.069	.049	.034	.040	.029	.020	.013	.009	.007		
8.0	.111	.074	.048	.095	.064	.042	.066	.045	.030	.038	.026	.018	.012	.009	.006		
9.0	.105	.068	.043	.091	.059	.038	.063	.042	.027	.037	.025	.016	.012	.008	.005		
10.0	.101	.064	.039	.087	.055	.034	.060	.039	.024	.035	.023	.014	.011	.008	.005		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm										
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D						WHType: 5W			Weight:	
SPEC.: 5000K						DIM.:			Instrument No.: HUP-IES-B3	
MFR.: CALEX						SUR.: 0.0475			shielding angle:	
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	11.1	11.9	11.3	12.1	12.3	11.1	11.9	11.3	12.1	12.3
3H	11.0	11.8	11.3	12.0	12.2	11.0	11.8	11.3	12.0	12.2
4H	11.0	11.8	11.3	12.0	12.3	11.0	11.8	11.3	12.0	12.2
6H	11.1	11.8	11.4	12.1	12.3	11.0	11.7	11.4	12.0	12.3
8H	11.2	11.8	11.5	12.1	12.4	11.1	11.7	11.4	12.0	12.3
12H	11.3	11.9	11.6	12.2	12.5	11.1	11.8	11.5	12.0	12.3
4H 2H	10.9	11.6	11.2	11.9	12.1	10.9	11.6	11.2	11.9	12.1
3H	10.9	11.5	11.2	11.8	12.1	10.9	11.5	11.2	11.8	12.1
4H	11.0	11.5	11.3	11.9	12.2	10.9	11.5	11.3	11.8	12.1
6H	11.1	11.6	11.5	12.0	12.3	11.0	11.5	11.4	11.9	12.2
8H	11.2	11.7	11.6	12.1	12.5	11.1	11.6	11.5	11.9	12.3
12H	11.4	11.8	11.8	12.2	12.7	11.2	11.6	11.6	12.0	12.5
8H 4H	10.9	11.4	11.3	11.7	12.1	10.9	11.3	11.3	11.7	12.1
6H	11.1	11.5	11.6	11.9	12.4	11.0	11.4	11.5	11.8	12.3
8H	11.3	11.7	11.8	12.1	12.6	11.2	11.5	11.6	12.0	12.4
12H	11.7	12.0	12.1	12.4	12.9	11.4	11.7	11.9	12.2	12.7
12H 4H	10.9	11.3	11.3	11.7	12.1	10.8	11.3	11.3	11.7	12.1
6H	11.1	11.5	11.6	11.9	12.4	11.0	11.4	11.5	11.8	12.3
8H	11.4	11.7	11.9	12.1	12.6	11.2	11.5	11.7	12.0	12.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.1 / - 3.7					+ 2.1 / - 4.0				
1.5H	+ 4.0 / - 3.8					+ 4.0 / - 4.1				
2.0H	+ 3.8 / - 1.2					+ 4.1 / - 1.5				

CIE Pub.117, 437.7 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -2.9)
Area: 0.00708 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	86	80	77	86	80	77	73
0.80	94	88	85	94	88	85	92	87	84	80
1.00	99	93	89	98	93	89	96	92	89	84
1.25	103	97	94	102	97	94	99	96	93	88
1.50	105	101	97	104	100	97	102	98	95	91
2.00	108	104	101	107	103	100	104	101	98	93
2.50	110	106	103	108	105	102	105	102	100	94
3.00	111	108	105	109	106	104	106	103	101	95
4.00	113	111	108	111	109	107	107	105	104	96
5.00	115	112	110	112	110	109	108	107	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Chen Songyu
Test Date: 2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 9.520m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

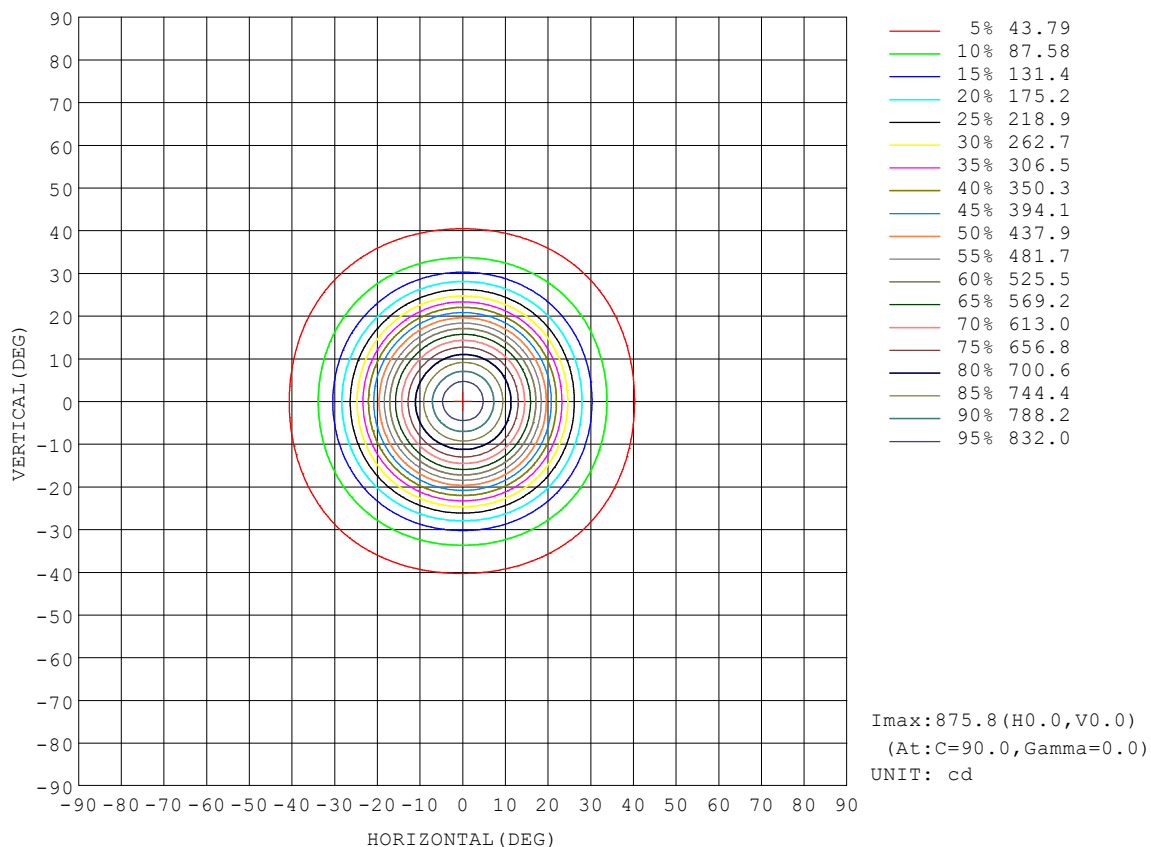


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

AAI Figure

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

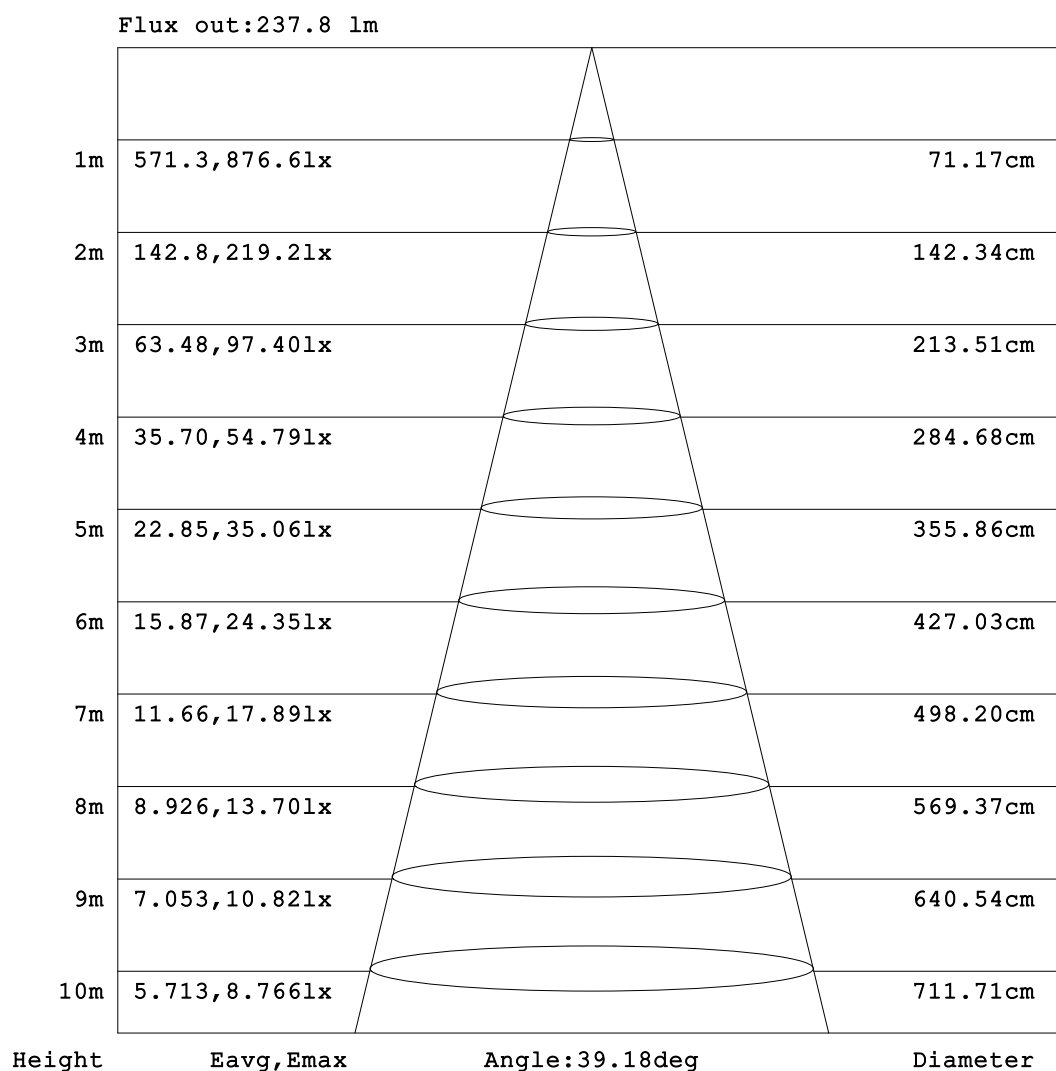


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: Chen Songyu
 Test Date: 2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000H_V1 SYSTEM V2.00.456
 Humidity: 65.0%
 Test Distance: 9.520m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

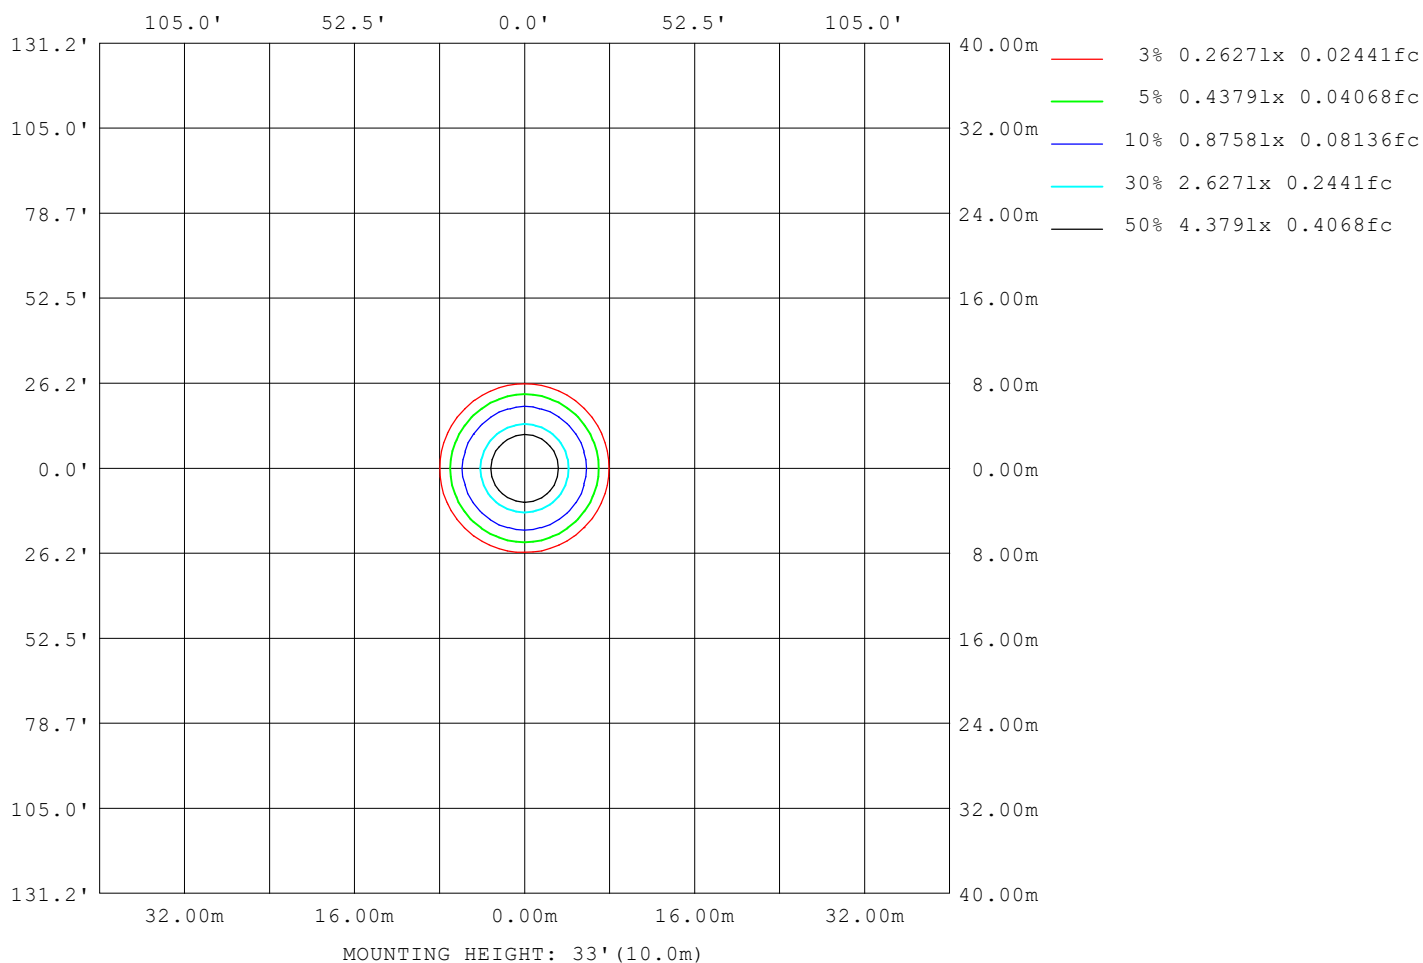

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Chen Songyu
Test Date:2026-02-08

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:9.520m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:


AvgL	cd/m2
L_0~180 (65) av	719
L_0~180 (75) av	800
L_0~180 (85) av	1623
L_90~270 (65) av	728
L_90~270 (75) av	793
L_90~270 (85) av	1560
L_45 (65) av	728
L_45 (75) av	826
L_45 (85) av	1644

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Chen Songyu
 Test Date:2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456
 Humidity:65.0%
 Test Distance:9.520m [K=1.0000]
 Remarks:

Planar Illuminance Curve

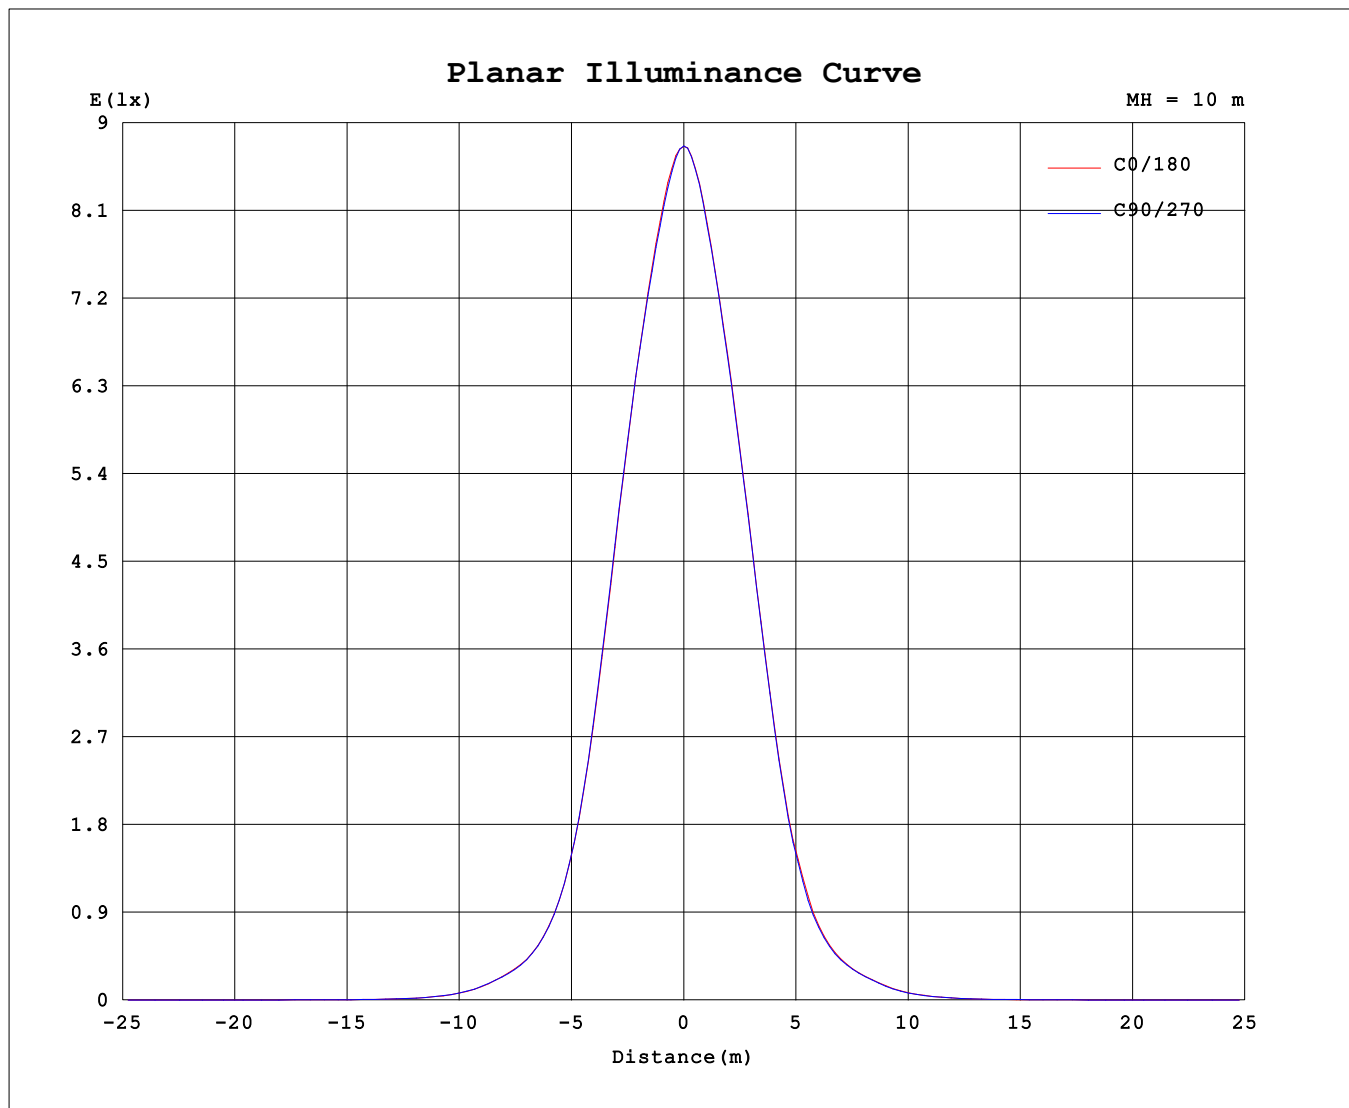

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: Chen Songyu
 Test Date: 2026-02-08

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000H_V1 SYSTEM V2.00.456
 Humidity: 65.0%
 Test Distance: 9.520m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:230.24V I:0.0236A P:4.5778W PF:0.8426 Freq:49.99Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:437.652x1 lm		
Name: Calex Luxor LX95 5-7-8-10W 3CT Triac dim 40D	WHType: 5W	Weight:
SPEC.: 5000K	DIM.:	Instrument No.: HUP-IES-B3
MFR.: CALEX	SUR.: 0.0475	shielding angle:

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	45	90	135	180	225	270	315										
0	876	876	876	876	876	876	876	876										
5	829	828	824	827	828	823	826	829										
10	732	734	730	729	726	718	723	729										
15	598	605	601	595	593	583	591	595										
20	423	430	426	426	424	415	422	422										
25	251	255	252	256	255	246	251	253										
30	136	138	136	138	139	133	135	136										
35	76.3	76.4	75.3	77.7	77.3	75.0	75.6	76.7										
40	45.4	45.5	45.5	47.4	47.3	45.7	46.0	45.8										
45	20.5	20.9	20.9	21.9	22.1	21.4	21.3	20.8										
50	8.30	8.50	8.47	8.96	9.05	8.88	8.90	8.52										
55	4.01	3.97	3.92	4.03	4.03	4.10	4.20	4.12										
60	2.90	2.86	2.77	2.80	2.81	2.85	2.98	2.98										
65	2.22	2.16	2.10	2.07	2.08	2.15	2.26	2.33										
70	1.80	1.73	1.66	1.62	1.64	1.73	1.81	1.95										
75	1.55	1.47	1.36	1.34	1.39	1.50	1.55	1.74										
80	1.29	1.20	1.07	1.04	1.10	1.21	1.25	1.46										
85	1.09	0.99	0.91	0.86	0.92	1.02	1.02	1.18										
90	0.87	0.81	0.76	0.71	0.75	0.84	0.83	0.93										
95	0.14	0.15	0.19	0.10	0.08	0.08	0.19	0.19										
100	0.07	0.12	0.26	0.12	0.07	0.08	0.33	0.08										
105	0.07	0.22	0.27	0.22	0.09	0.23	0.22	0.21										
110	0.14	0.22	0.38	0.22	0.15	0.23	0.38	0.22										
115	0.19	0.25	0.37	0.24	0.29	0.23	0.39	0.24										
120	0.29	0.31	0.39	0.31	0.42	0.32	0.45	0.32										
125	0.54	0.42	0.53	0.43	0.59	0.42	0.60	0.42										
130	0.78	0.66	0.77	0.67	0.85	0.70	0.79	0.71										
135	1.04	1.00	1.04	1.02	1.11	1.08	1.05	1.07										
140	1.37	1.41	1.44	1.42	1.48	1.49	1.47	1.49										
145	1.84	1.84	1.93	1.85	1.96	1.96	1.95	1.96										
150	2.48	2.32	2.40	2.32	2.55	2.40	2.43	2.41										
155	2.74	2.76	2.77	2.75	2.83	2.80	2.84	2.82										
160	3.07	3.12	3.11	3.10	3.13	3.11	3.16	3.15										
165	3.42	3.38	3.33	3.33	3.43	3.31	3.36	3.37										
170	3.47	3.42	3.41	3.38	3.43	3.36	3.42	3.40										
175	3.44	3.50	3.42	3.47	3.44	3.43	3.43	3.47										
180	3.48	3.49	3.45	3.49	3.47	3.49	3.47	3.48										

C Range: 0 - 360DEG

C Interval: 45.0DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Chen Songyu

Test Date:2026-02-08

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-2000H_V1 SYSTEM V2.00.456

Humidity:65.0%

Test Distance:9.520m [K=1.0000]

Remarks: